Oneness Nanchou Plant
Self-testing of effluent quality for January 2026

ONENESS
合一生技股份有限公司
ONENESS BIOTECH CO., LTD.

Self-testing of effluent quality meets standards

All of the COD values of effluent are lower than 99mg/L in compliance with environmental laws, regulations, and codes.

The average COD value of wastewater was 1500mg/L.

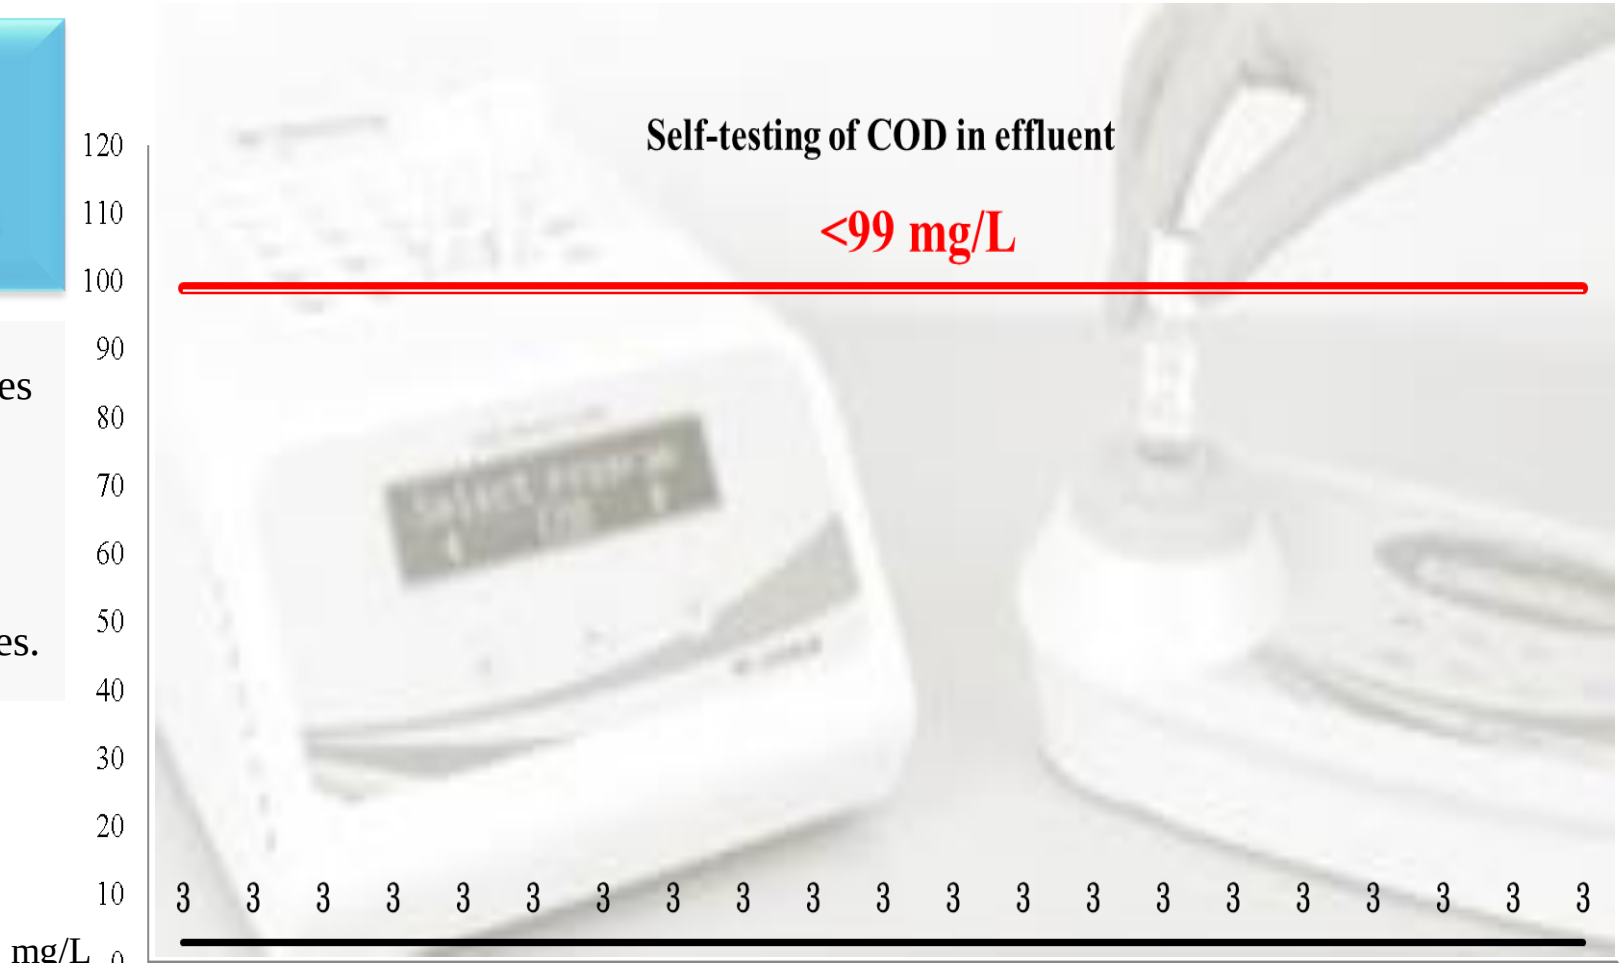

	1/2	1/5	1/6	1/7	1/8	1/9	1/12	1/13	1/14	1/15	1/16	1/19	1/20	1/21	1/22	1/23	1/26	1/27	1/28	1/29	1/30
COD test value (mg/L)	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3
COD upper limit (mg/L)	99	99	99	99	99	99	99	99	99	99	99	99	99	99	99	99	99	99	99	99	99