Oneness Nanchou Plant
Self-testing of effluent quality for February 2026

ONENESS
合一生技股份有限公司
ONENESS BIOTECH CO., LTD.

Self-testing of effluent quality meets standards

All of the COD values of effluent are lower than 99mg/L in compliance with environmental laws, regulations, and codes.

The average COD value of wastewater was 1500mg/L.

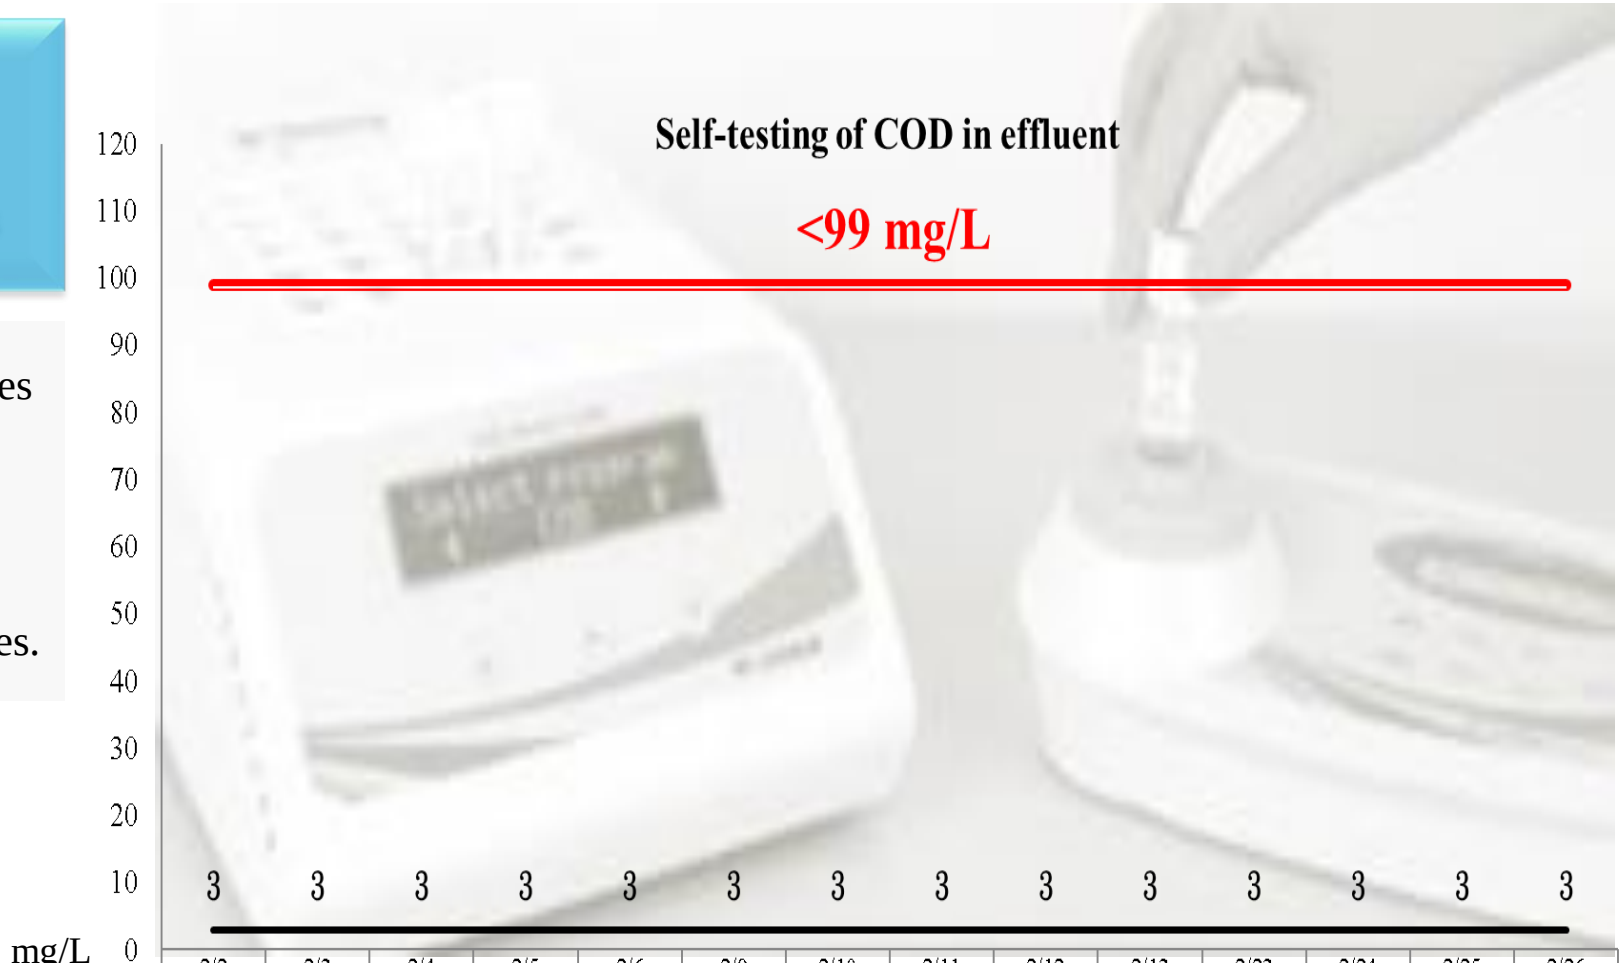

	2/2	2/3	2/4	2/5	2/6	2/9	2/10	2/11	2/12	2/13	2/23	2/24	2/25	2/26
COD test value (mg/L)	3	3	3	3	3	3	3	3	3	3	3	3	3	3
COD upper limit (mg/L)	99	99	99	99	99	99	99	99	99	99	99	99	99	99